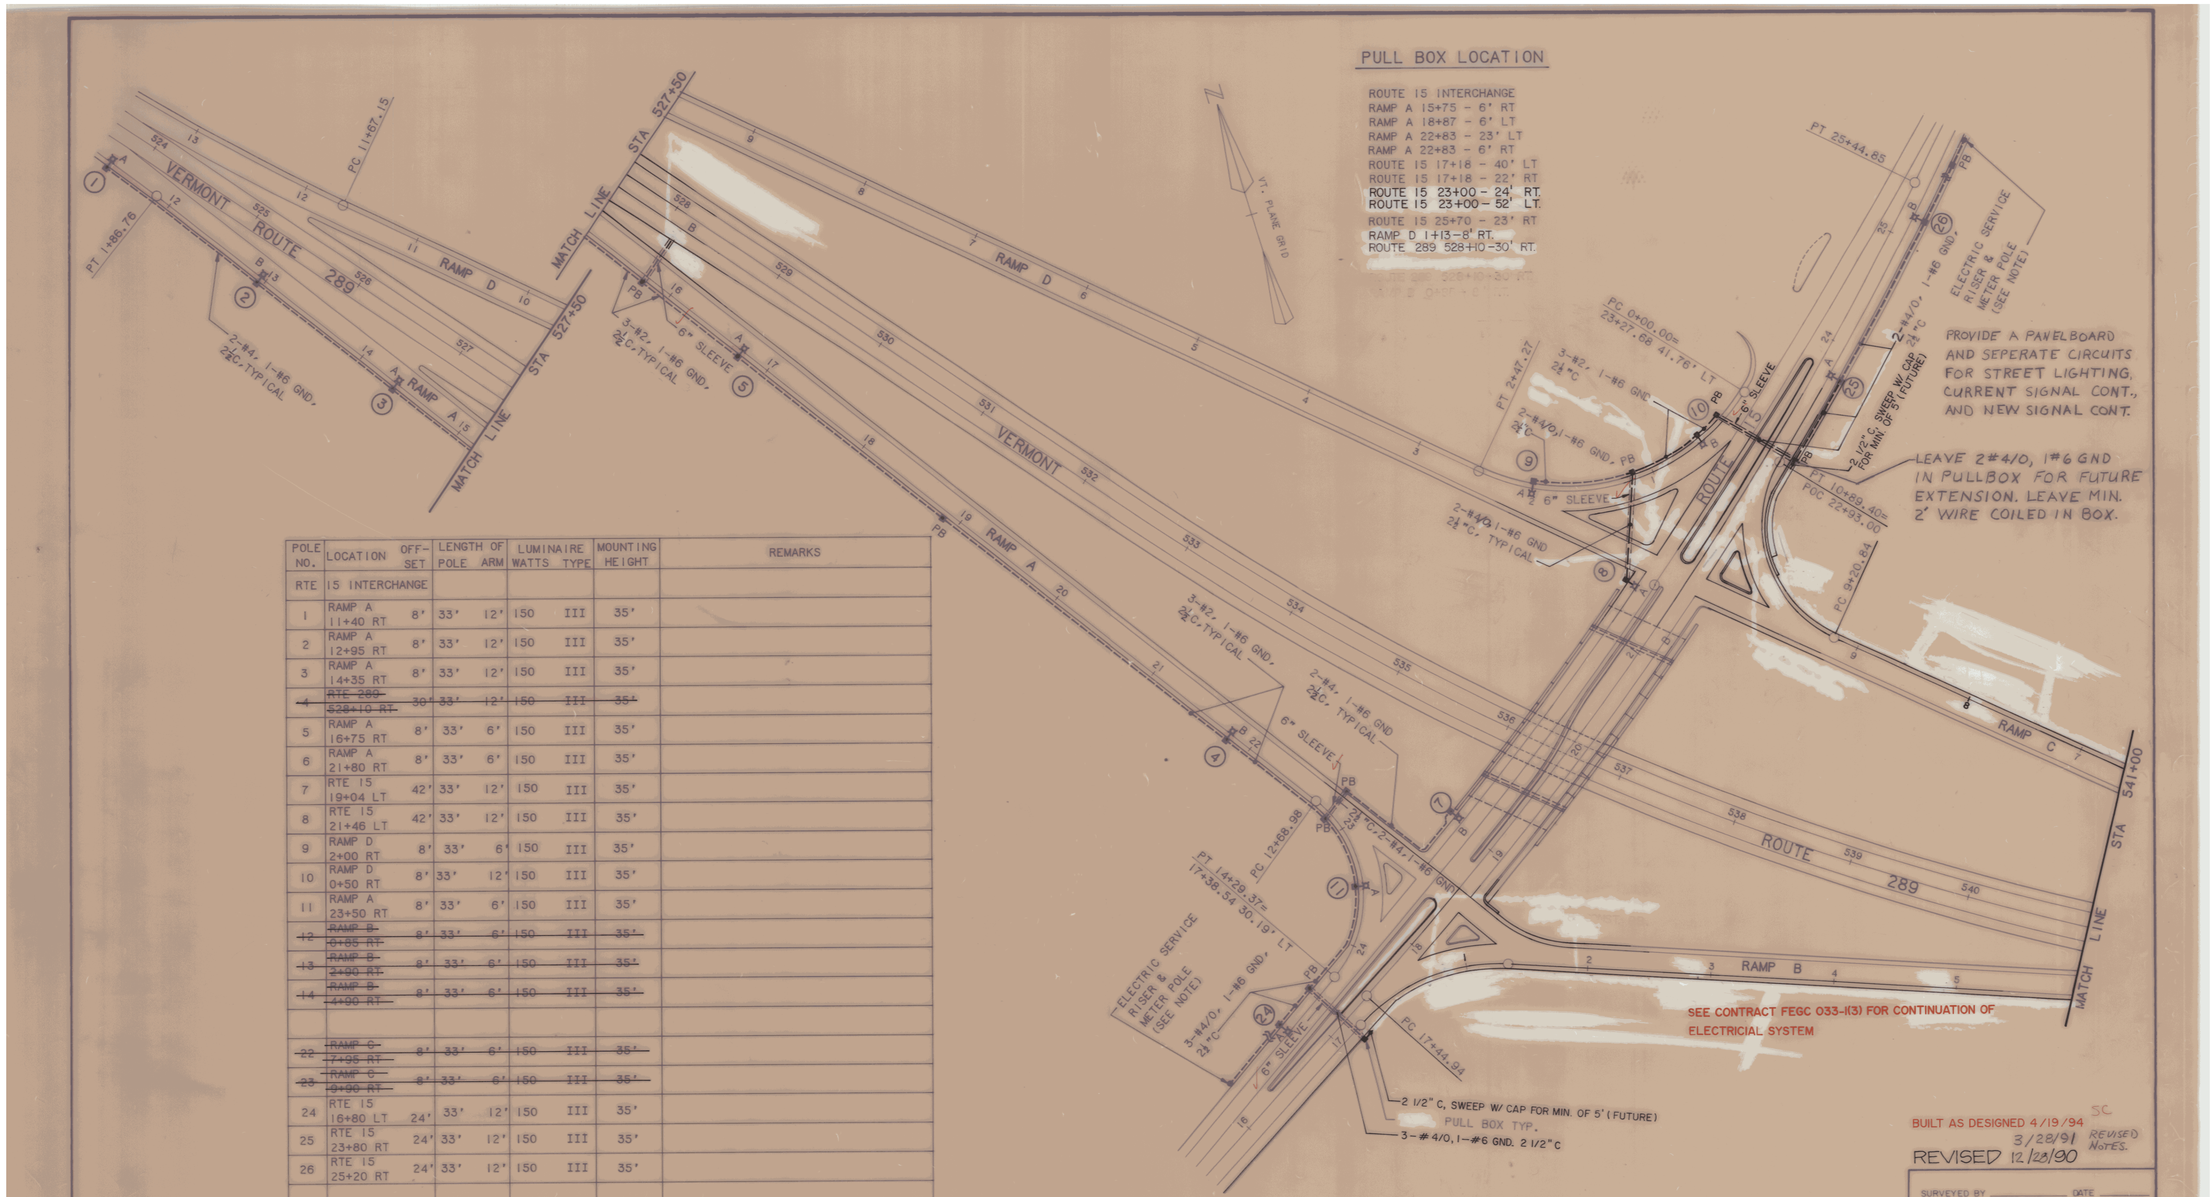


POLE NO.	LOCATION	OFF-SET	LENGTH OF POLE ARM	LUMINAIRE WATTS	LUMINAIRE TYPE	MOUNTING HEIGHT	REMARKS
RTE	15 INTERCHANGE						
1	RAMP A 11+40 RT	8'	33'	12'	150	III	35'	
2	RAMP A 12+95 RT	8'	33'	12'	150	III	35'	
3	RAMP A 14+35 RT	8'	33'	12'	150	III	35'	
~~4~~	~~RTE 289 528+10 RT.~~	~~30'~~	~~33'~~	~~12'~~	~~150~~	~~III~~	~~35'~~	
5	RAMP A 16+75 RT	8'	33'	6'	150	III	35'	
6	RAMP A 21+80 RT	8'	33'	6'	150	III	35'	
7	RTE 15 19+04 LT	42'	33'	12'	150	III	35'	
8	RTE 15 21+46 LT	42'	33'	12'	150	III	35'	
9	RAMP D 2+00 RT	8'	33'	6'	150	III	35'	
10	RAMP D 0+50 RT	8'	33'	12'	150	III	35'	
11	RAMP A 23+50 RT	8'	33'	6'	150	III	35'	
~~12~~	~~RAMP B 0+85 RT.~~	~~8'~~	~~33'~~	~~6'~~	~~150~~	~~III~~	~~35'~~	
~~13~~	~~RAMP B 2+90 RT.~~	~~8'~~	~~33'~~	~~6'~~	~~150~~	~~III~~	~~35'~~	
~~14~~	~~RAMP B 4+90 RT.~~	~~8'~~	~~33'~~	~~6'~~	~~150~~	~~III~~	~~35'~~	
~~22~~	~~RAMP C 7+95 RT.~~	~~8'~~	~~33'~~	~~6'~~	~~150~~	~~III~~	~~35'~~	
~~23~~	~~RAMP C 9+90 RT.~~	~~8'~~	~~33'~~	~~6'~~	~~150~~	~~III~~	~~35'~~	
24	RTE 15 16+80 LT	24'	33'	12'	150	III	35'	
25	RTE 15 23+80 RT	24'	33'	12'	150	III	35'	
26	RTE 15 25+20 RT	24'	33'	12'	150	III	35'	

DATUM
VERTICAL
HORIZONTAL

NOTES:

1. ELECTRIC SERVICE RISER & METER POLE TO BE 120/240 VOLT, SINGLE PHASE & 3 WIRE. PROVIDE METER SOCKET CABINET & SERVICE SWITCH AS REQUIRED. POLE LOCATION TO BE VERIFIED IN FIELD.

BUILT AS DESIGNED 4/19/94 SC
3/28/91 REVISED NOTES.
REVISED 12/28/90

SURVEYED BY _____ DATE _____
DRAWN BY E.A.G. DATE 8/88
TRACED BY J.B.C. DATE 9/88

VERMONT ROUTE 289 (F.A.P.)
TOWN OF ESSEX
PROJ Williston-Colchester NO. PB-033-1(2)
SHEET 115 OF 400