


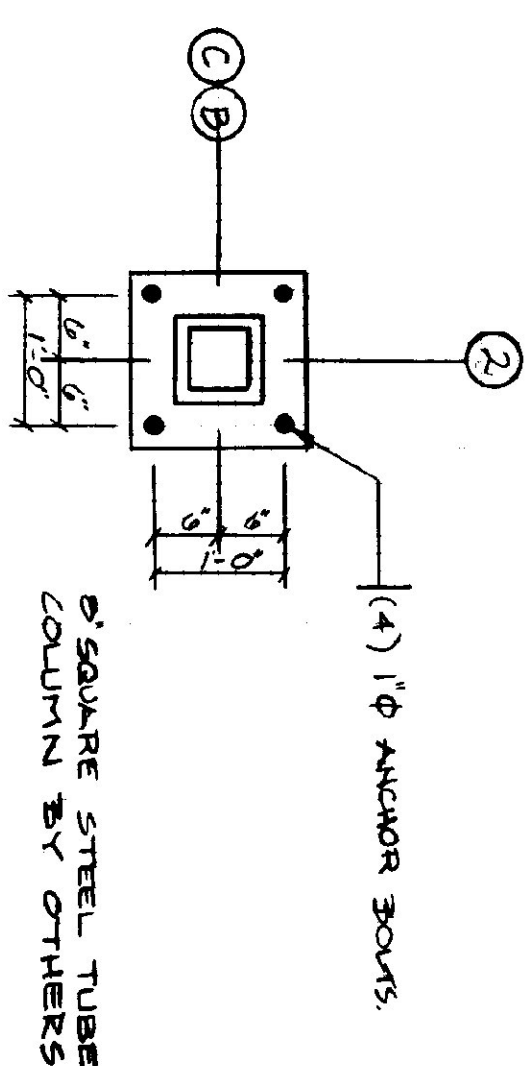
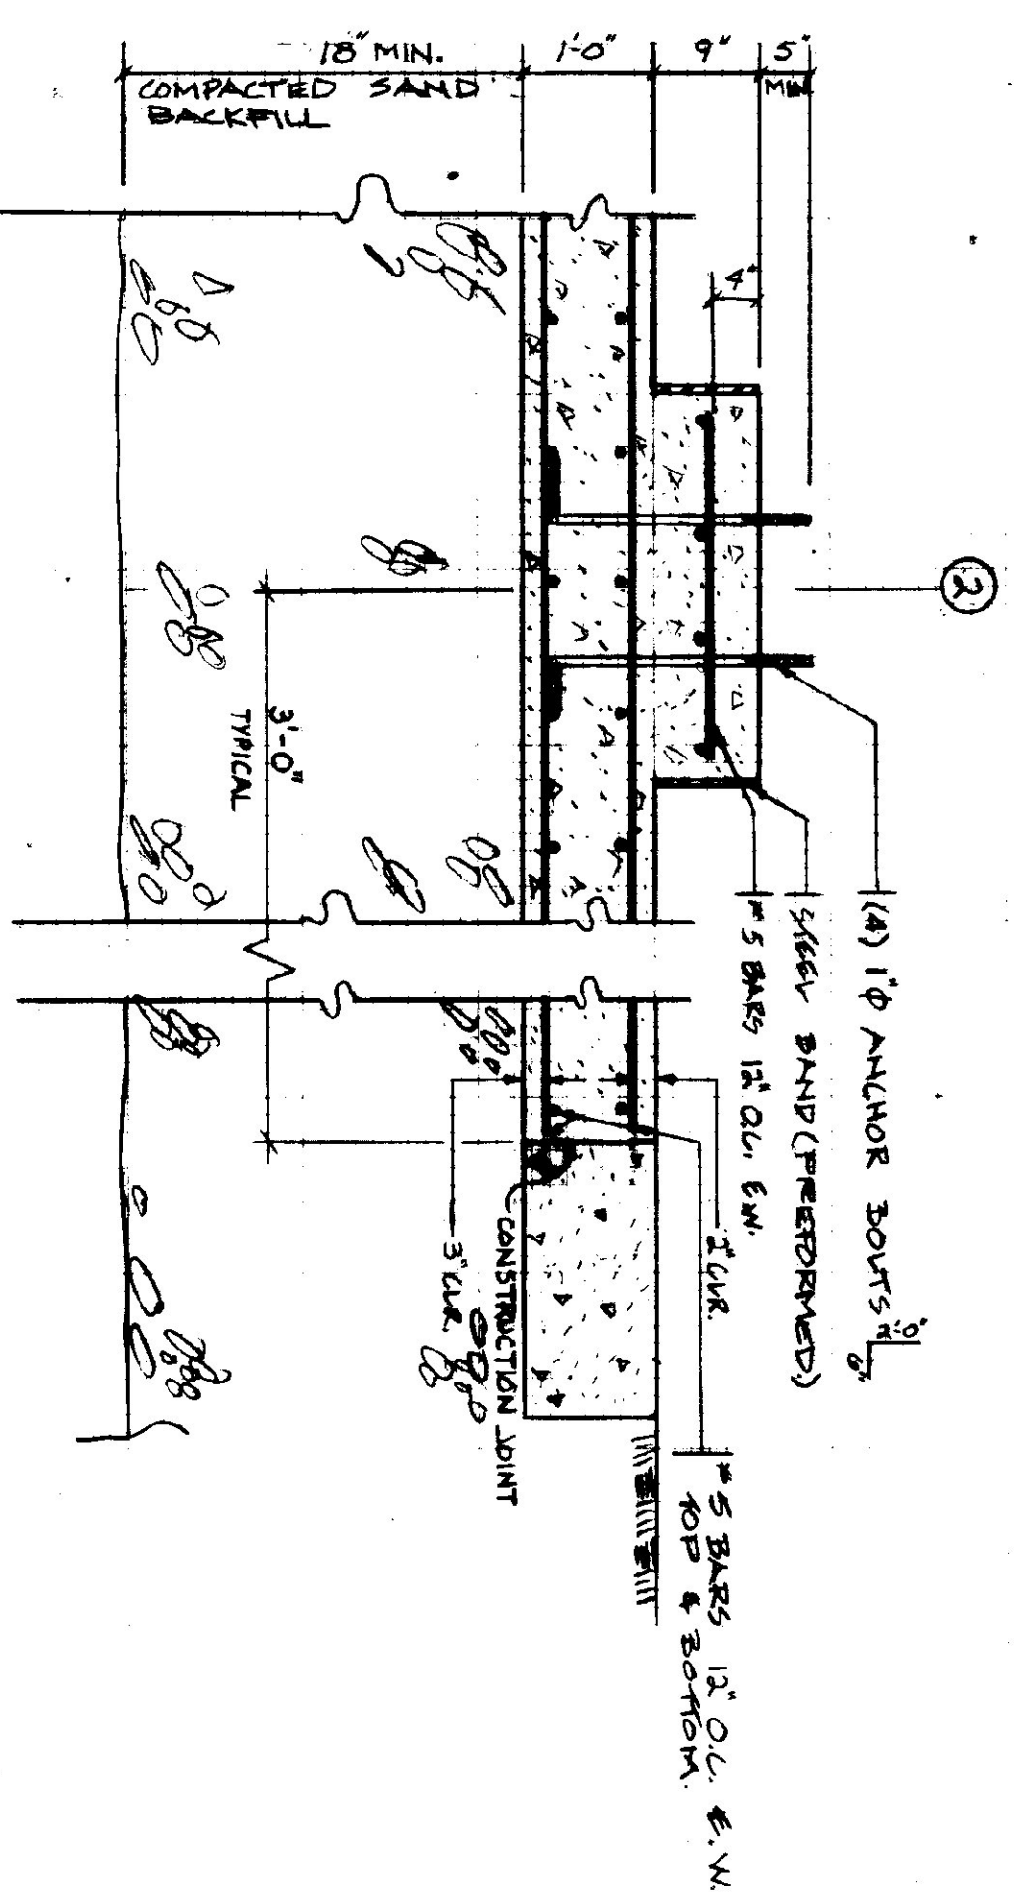
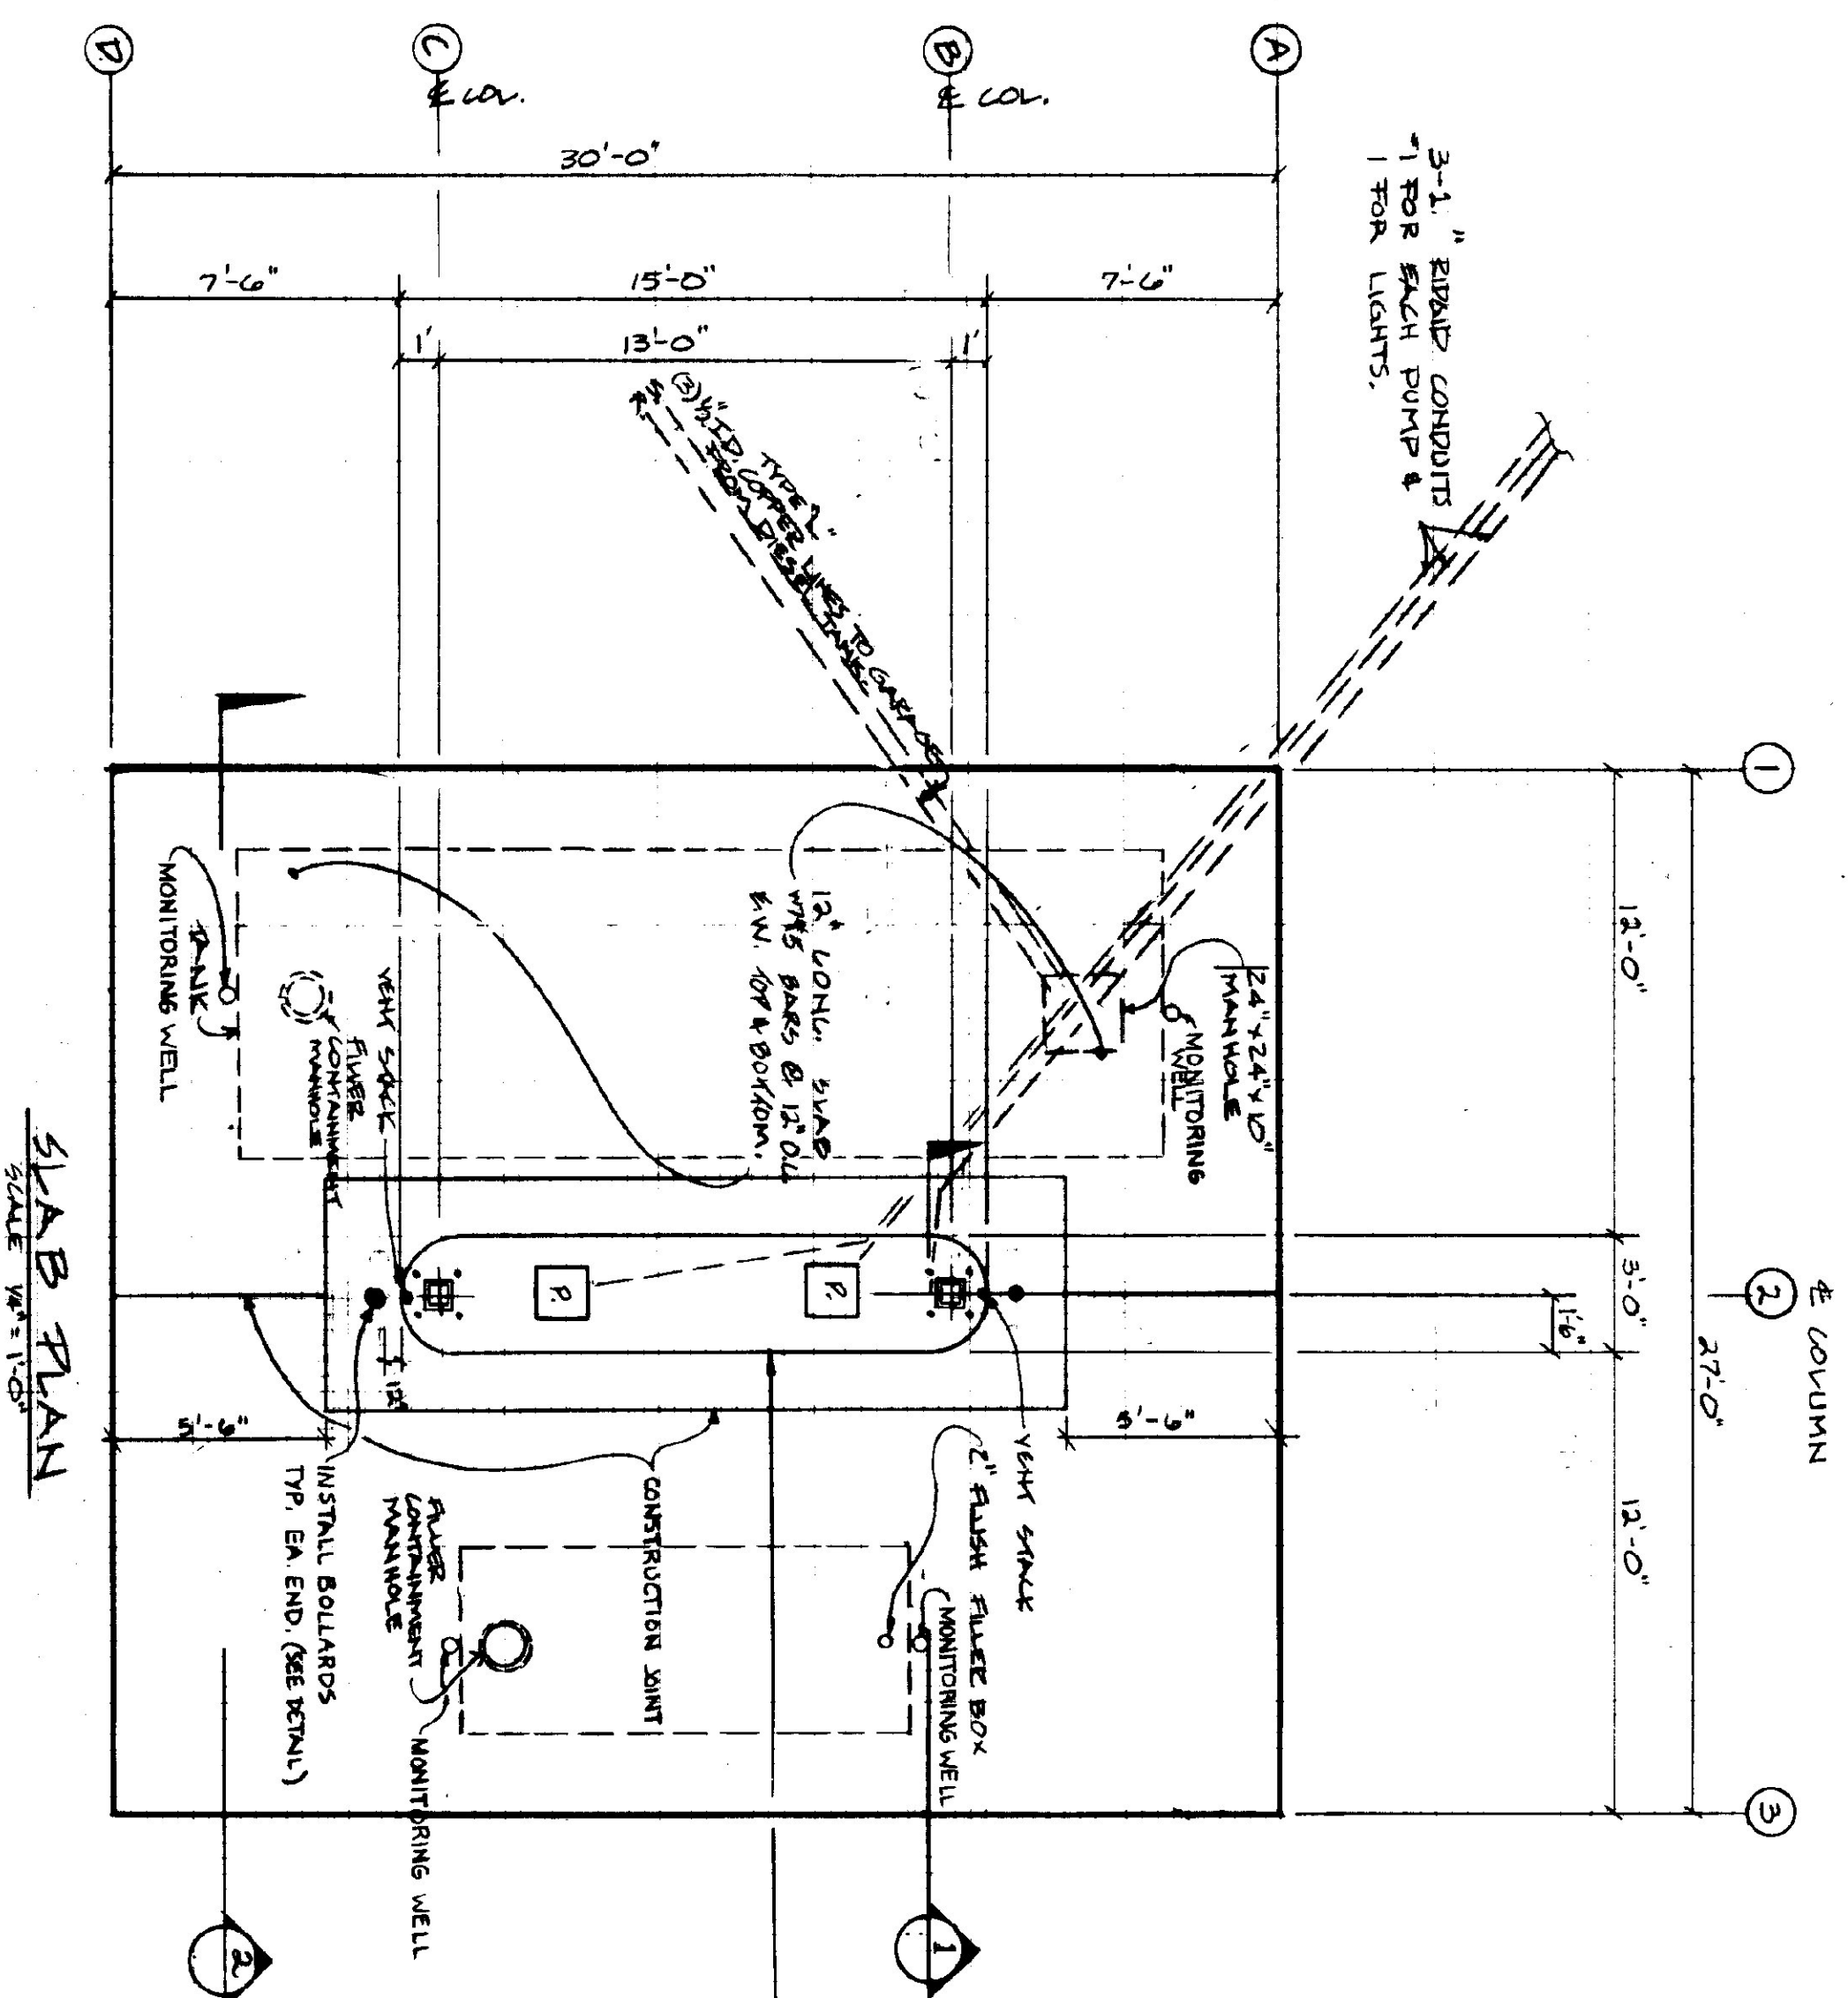


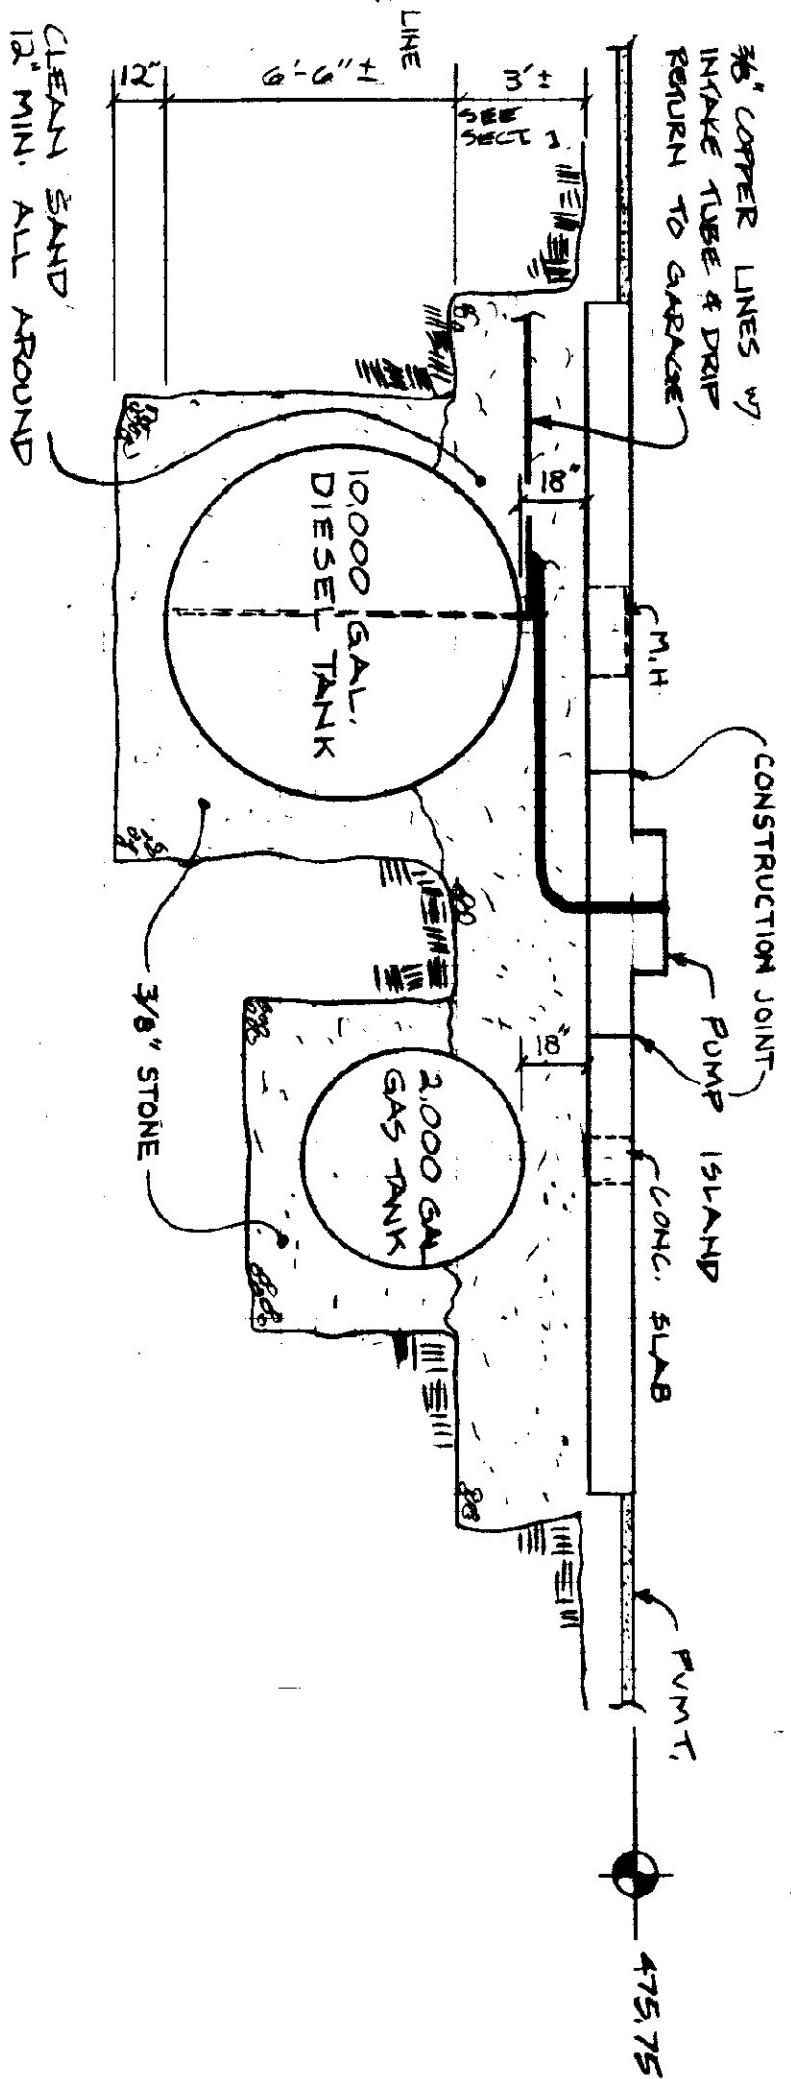

- 1) ALL CONCRETE SHALL BE NORMAL WEIGHT HAVING A MINIMUM STRENGTH OF 4000 PSI AT 28 DAYS. CLASS A CONCRETE PER STATE OF VERMONT AGENCY OF TRANSPORTATION "STANDARD SPECIFICATIONS FOR CONSTRUCTION."
- 2) REINFORCING STEEL SHALL COMPLY WITH ASTM A615, GRADE 60.
- 3) ANCHOR BOLTS TO BE GRADE A307.

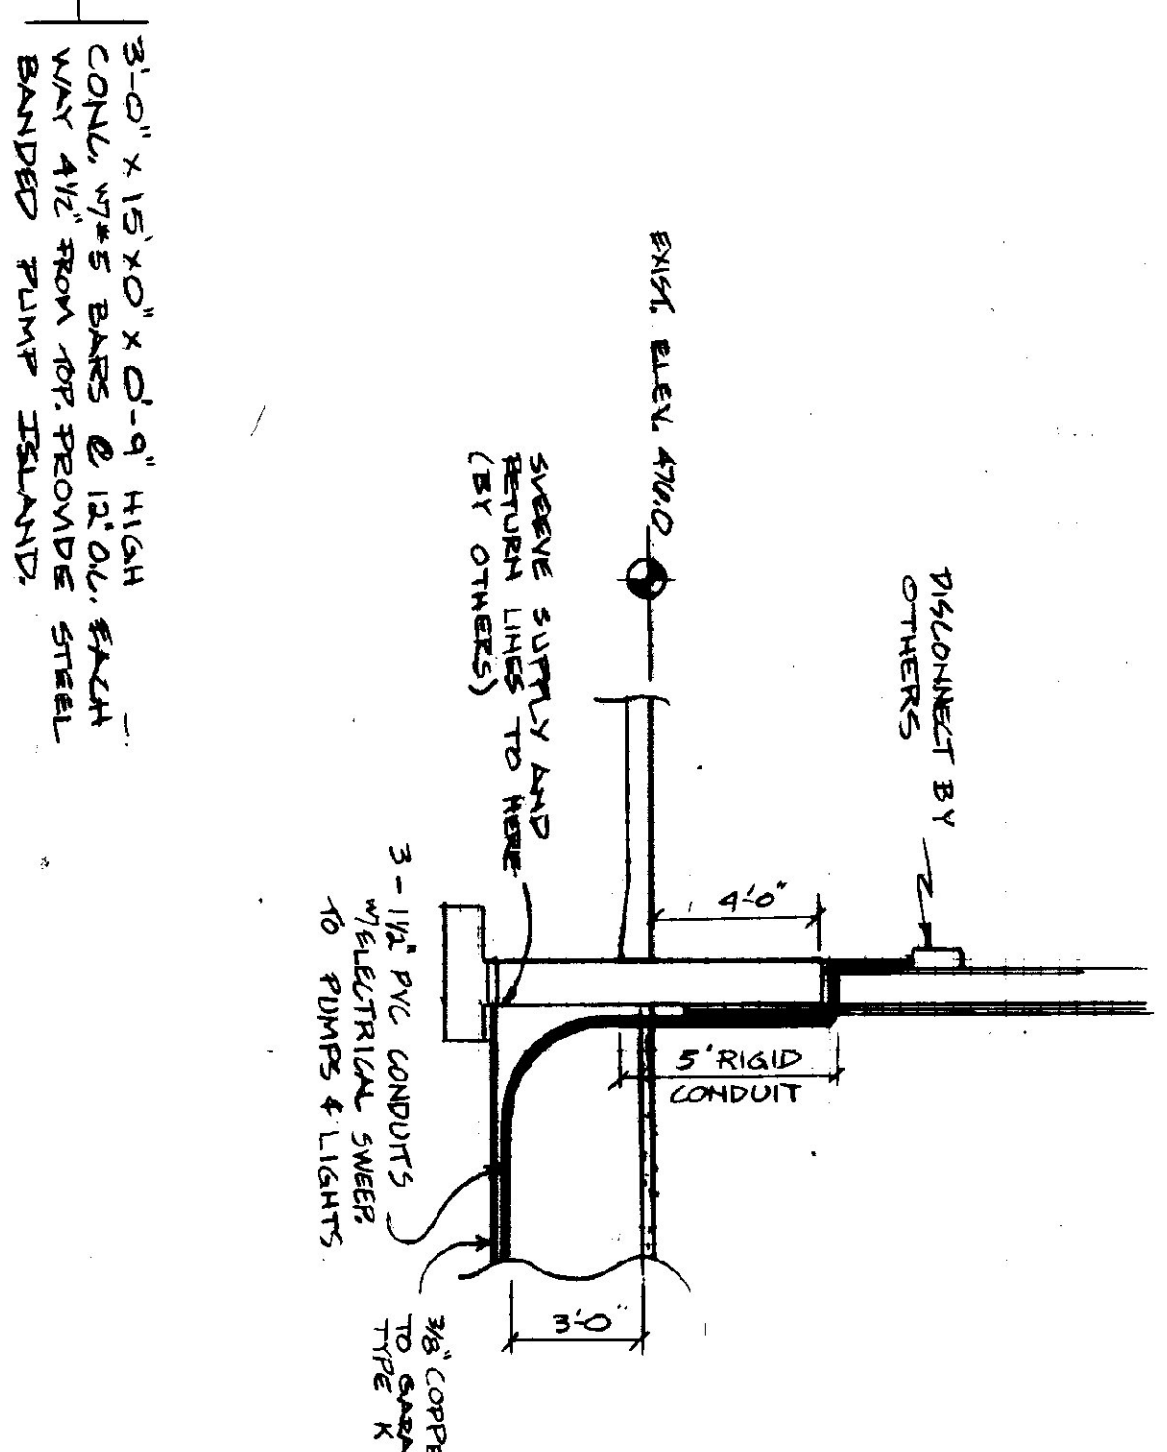

- NOTES: PUMP & TANKS
- 1) PROVIDE 1 GAS BOX 50" MODEL 512 C & CONNECT TO NEW 3,000 GAL. GAS TANK.
 - 2) PROVIDE 1 GAS BOX 50" MODEL 5300 TWIN PUMP & CONNECT TO NEW 10,000 GAL. DIESEL TANK.
 - 3) GAS & DIESEL TANK (STI-P3 SYSTEM DOUBLE WALL TANKS).

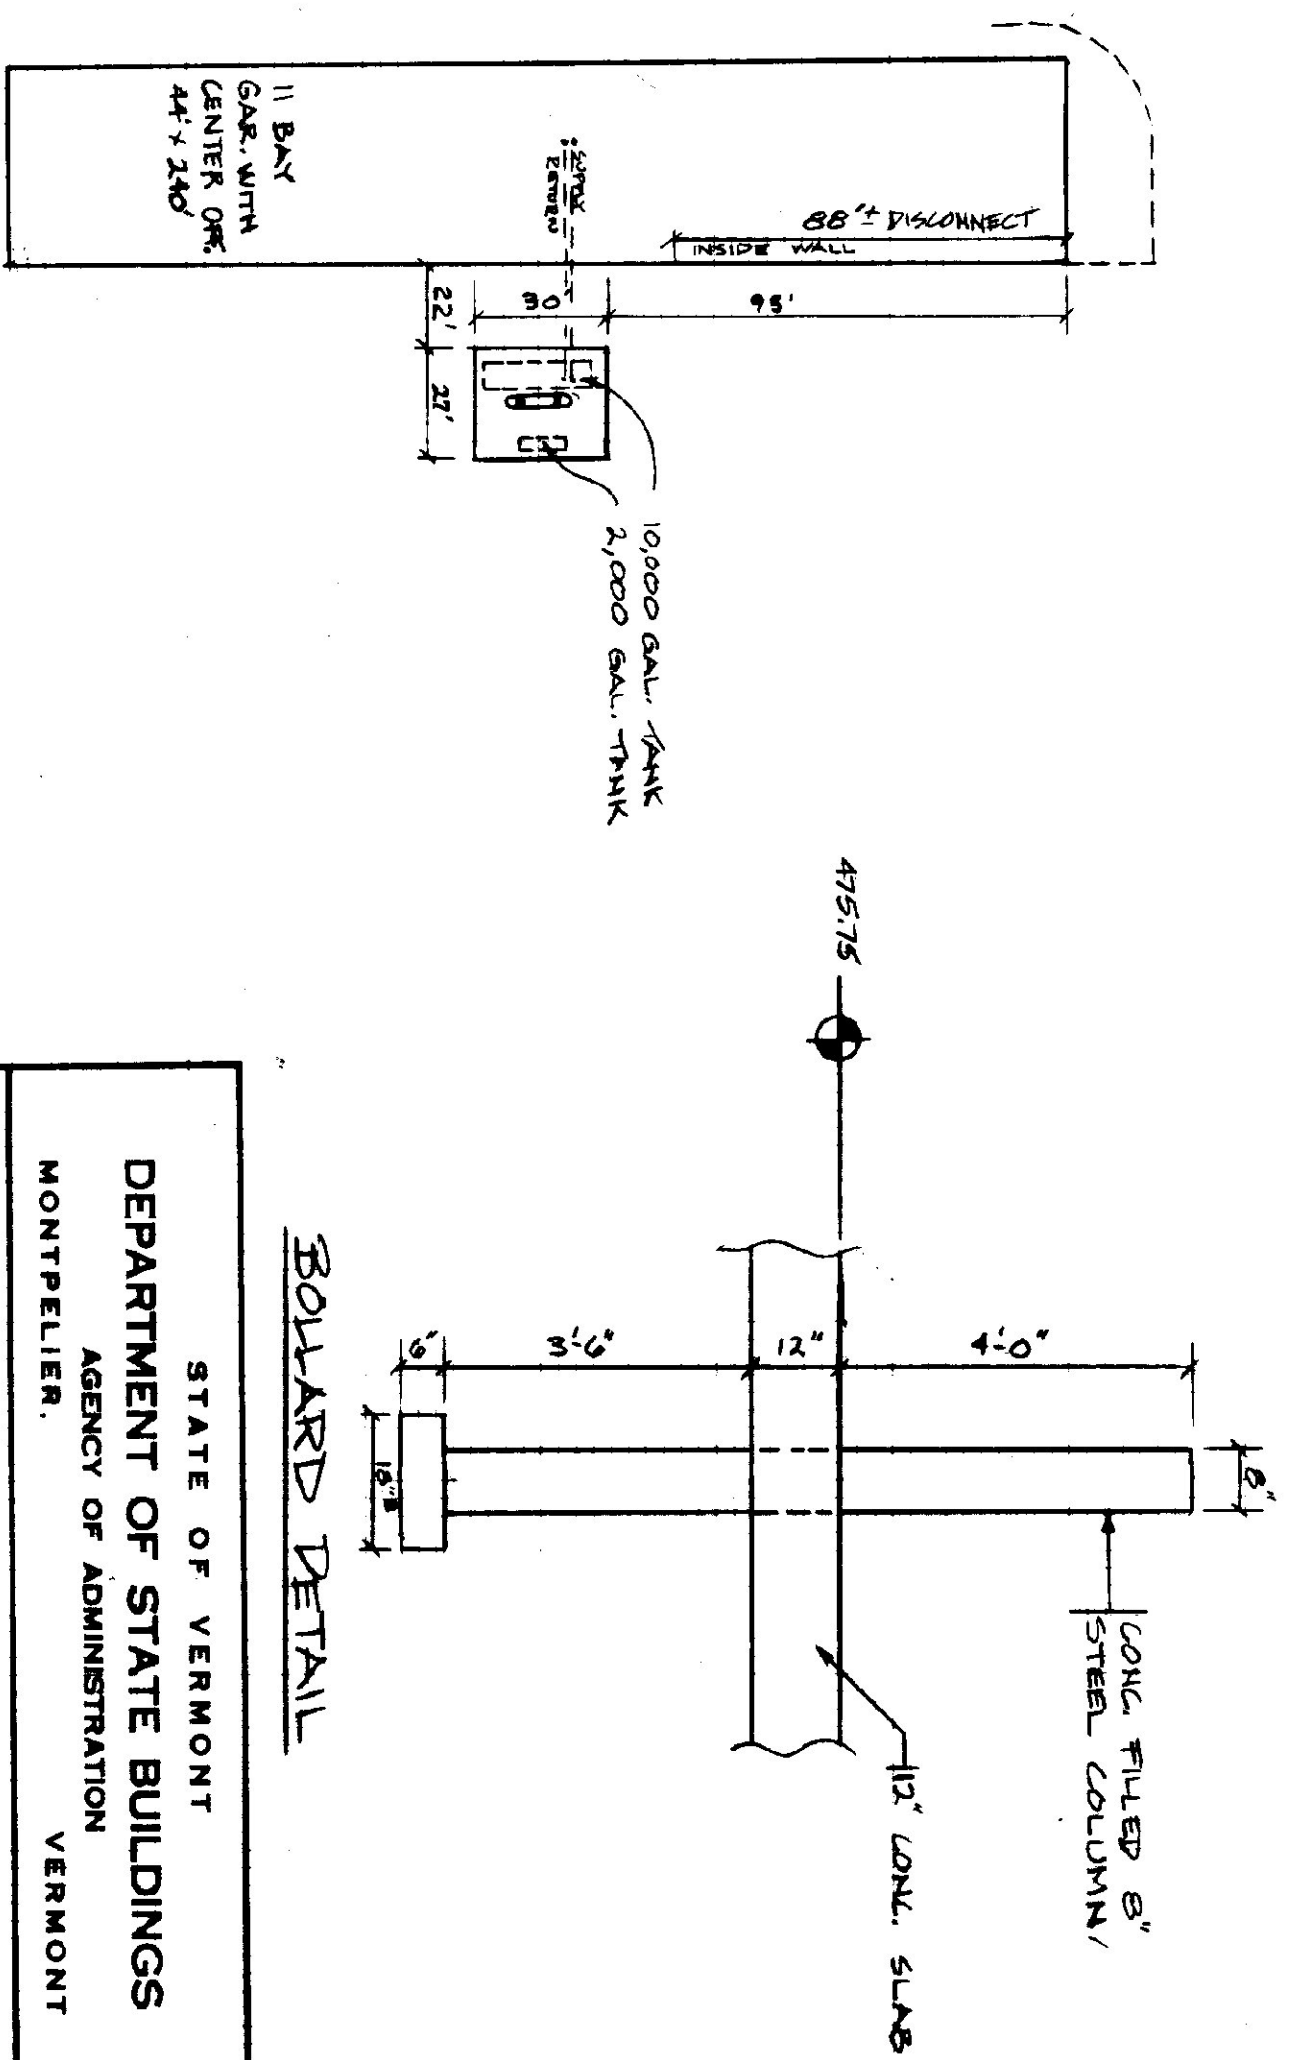

STATE OF VERMONT		FUEL ISLAND SLAB	
DEPARTMENT OF STATE BUILDINGS		# TANK PLAN/DETAIL	
AGENCY OF ADMINISTRATION		DUMMERSTON AOT GARAGE	
MONTPELIER.			
VERMONT			
DUMMERSTON			
DATE:	4-22-67	REVISIONS:	
DRAWN BY:	AS NOTED		
APPROVED BY:	7-31-67		
VERMONT			
DWG. NO.			
#-1			
1 OF 1			