

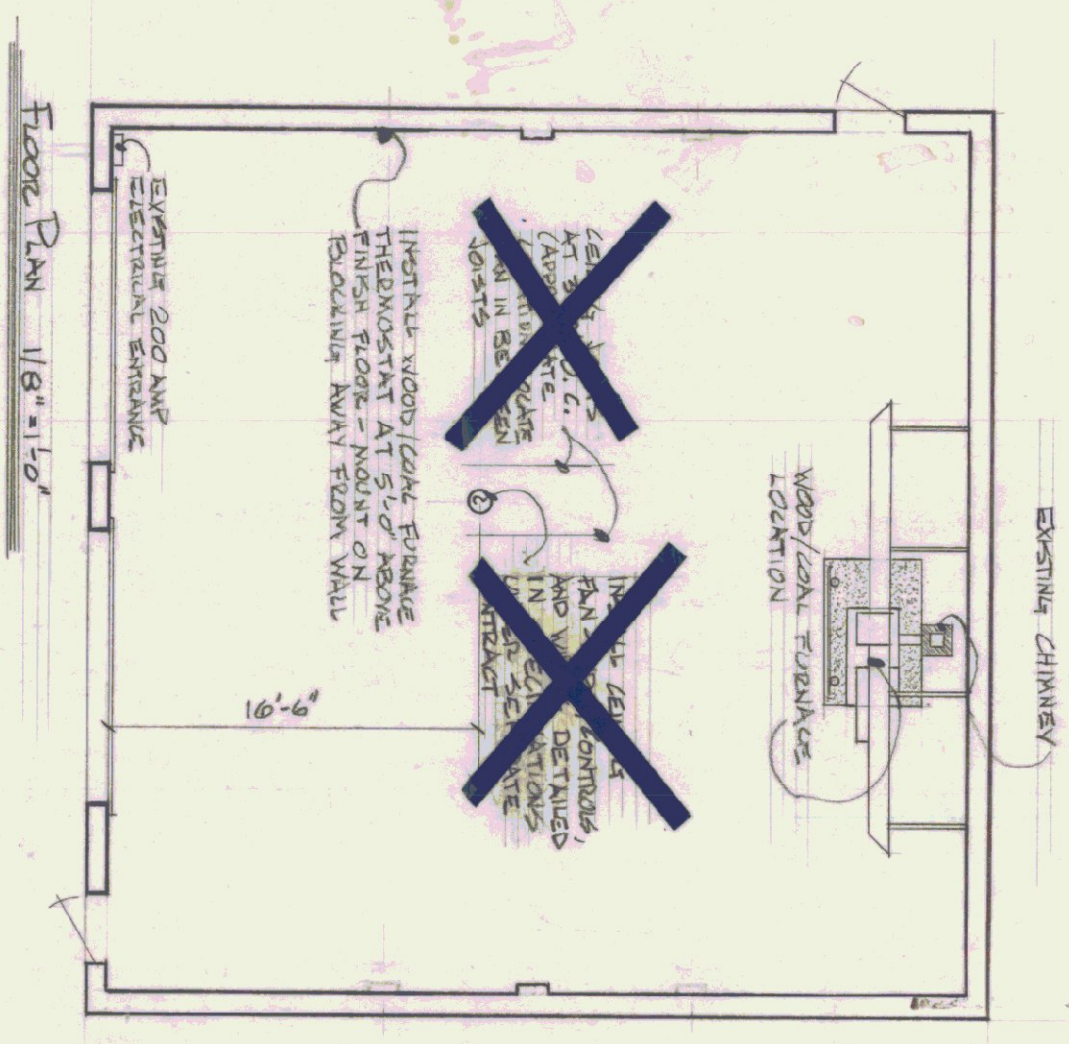
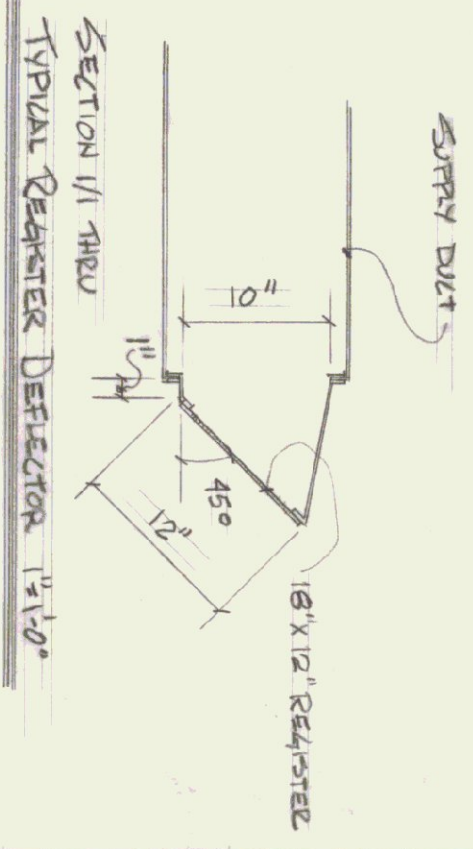
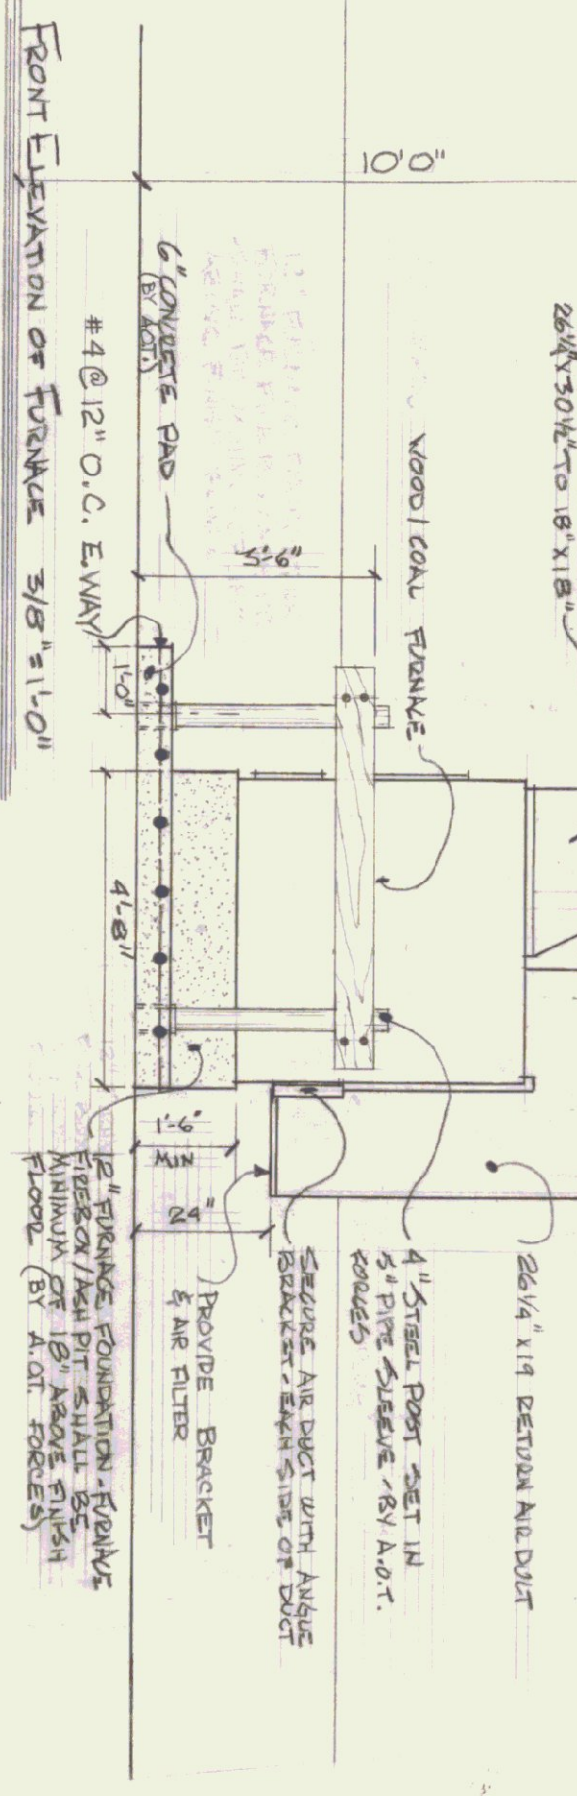


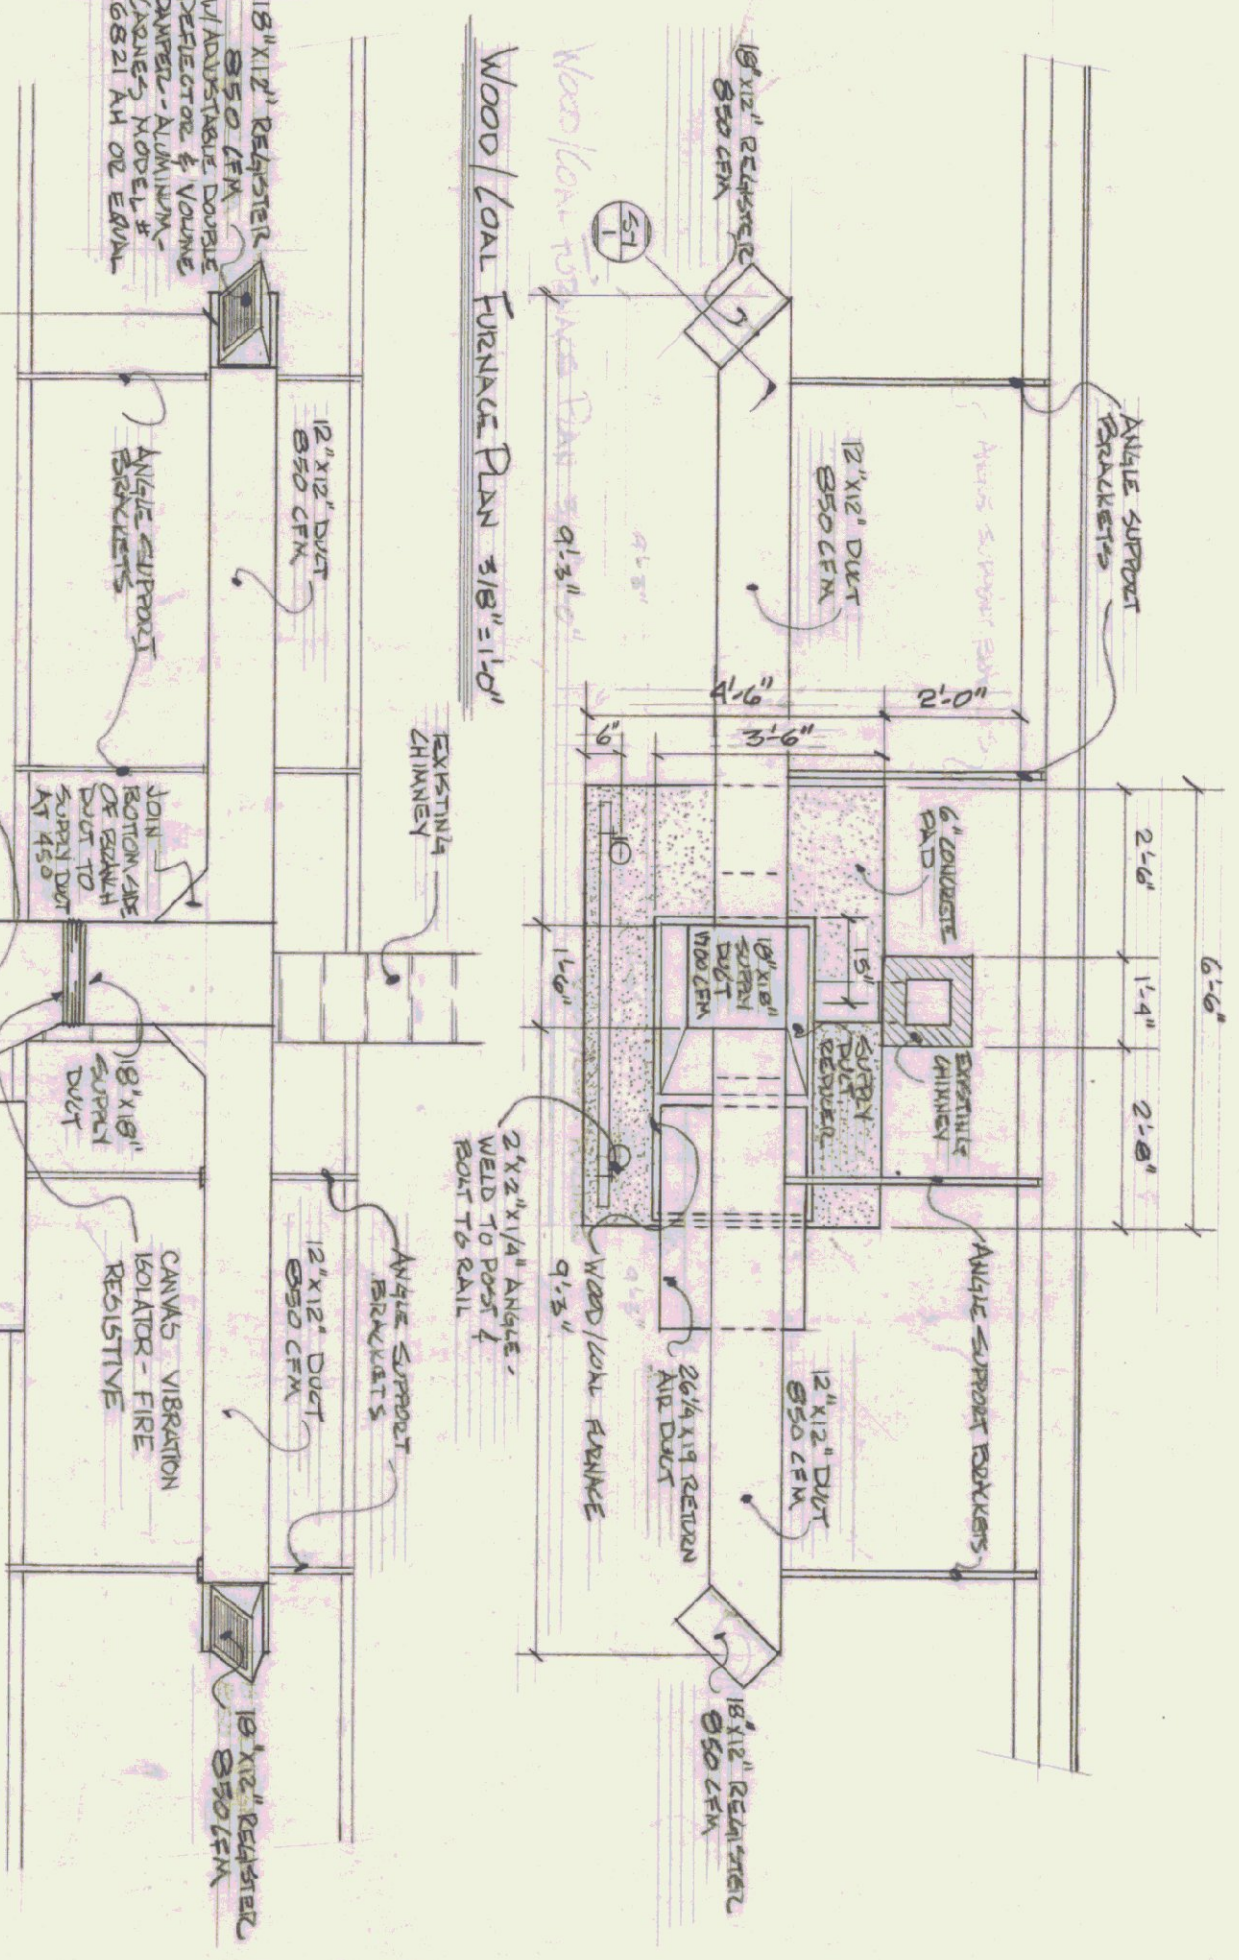

1. FURNACE LOCATED - SUPPLY AND INSTALL 150,000 BTU FURNACE AND ALL NECESSARY DUCTWORK AND ELECTRICAL WORK.

2. ALL WIRING TO BE INSTALLED IN E.M.T. ACCORDING TO THE NATIONAL ELECTRICAL CODE.

3. A.O.T. FORCES TO INSTALL PAD, FURNACE FOUNDATION, AND DUCTWORK.

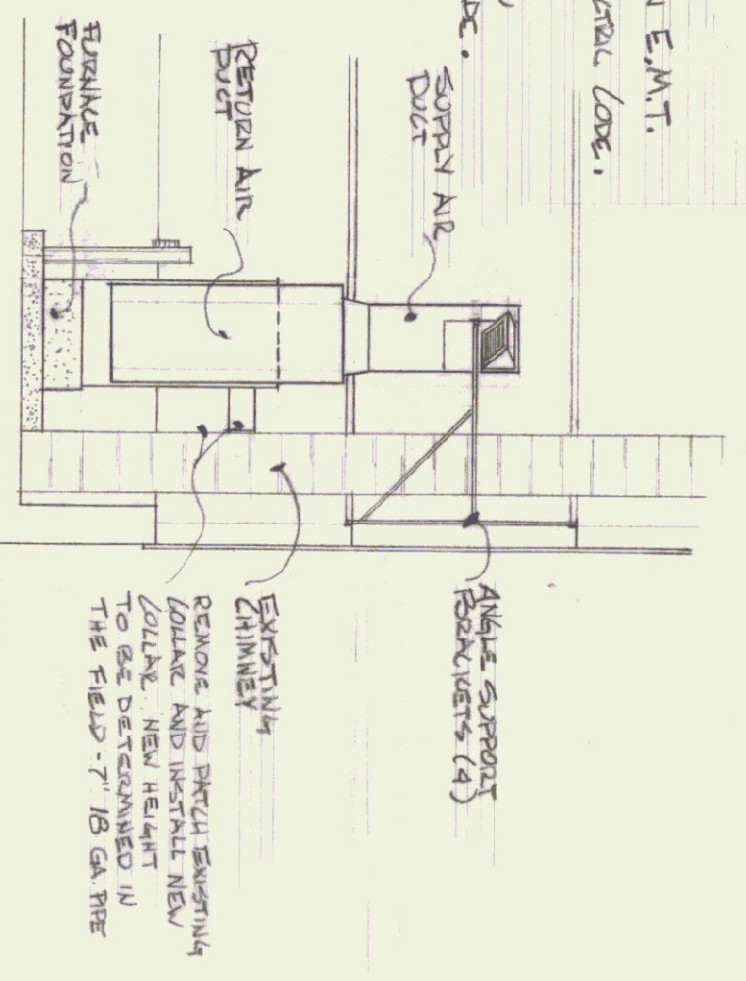

STATE OF VERMONT			
DIVISION OF STATE BUILDINGS			
AGENCY OF ADMINISTRATION			
MONTPELIER, VERMONT			
WOODBURNING FURNACE INSTALLATION			
AT THE AGENCY OF TRANSPORTATION (HARRIS)			
THURSDAY, VERMONT			
DATE:	SCALE:	REVISIONS:	DWG. NO.
4-2-81	AS SHOWN		
DRAWN BY:	APPROVED BY:		
HANSON			
			1 OF 1