
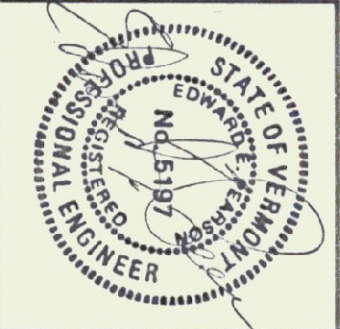
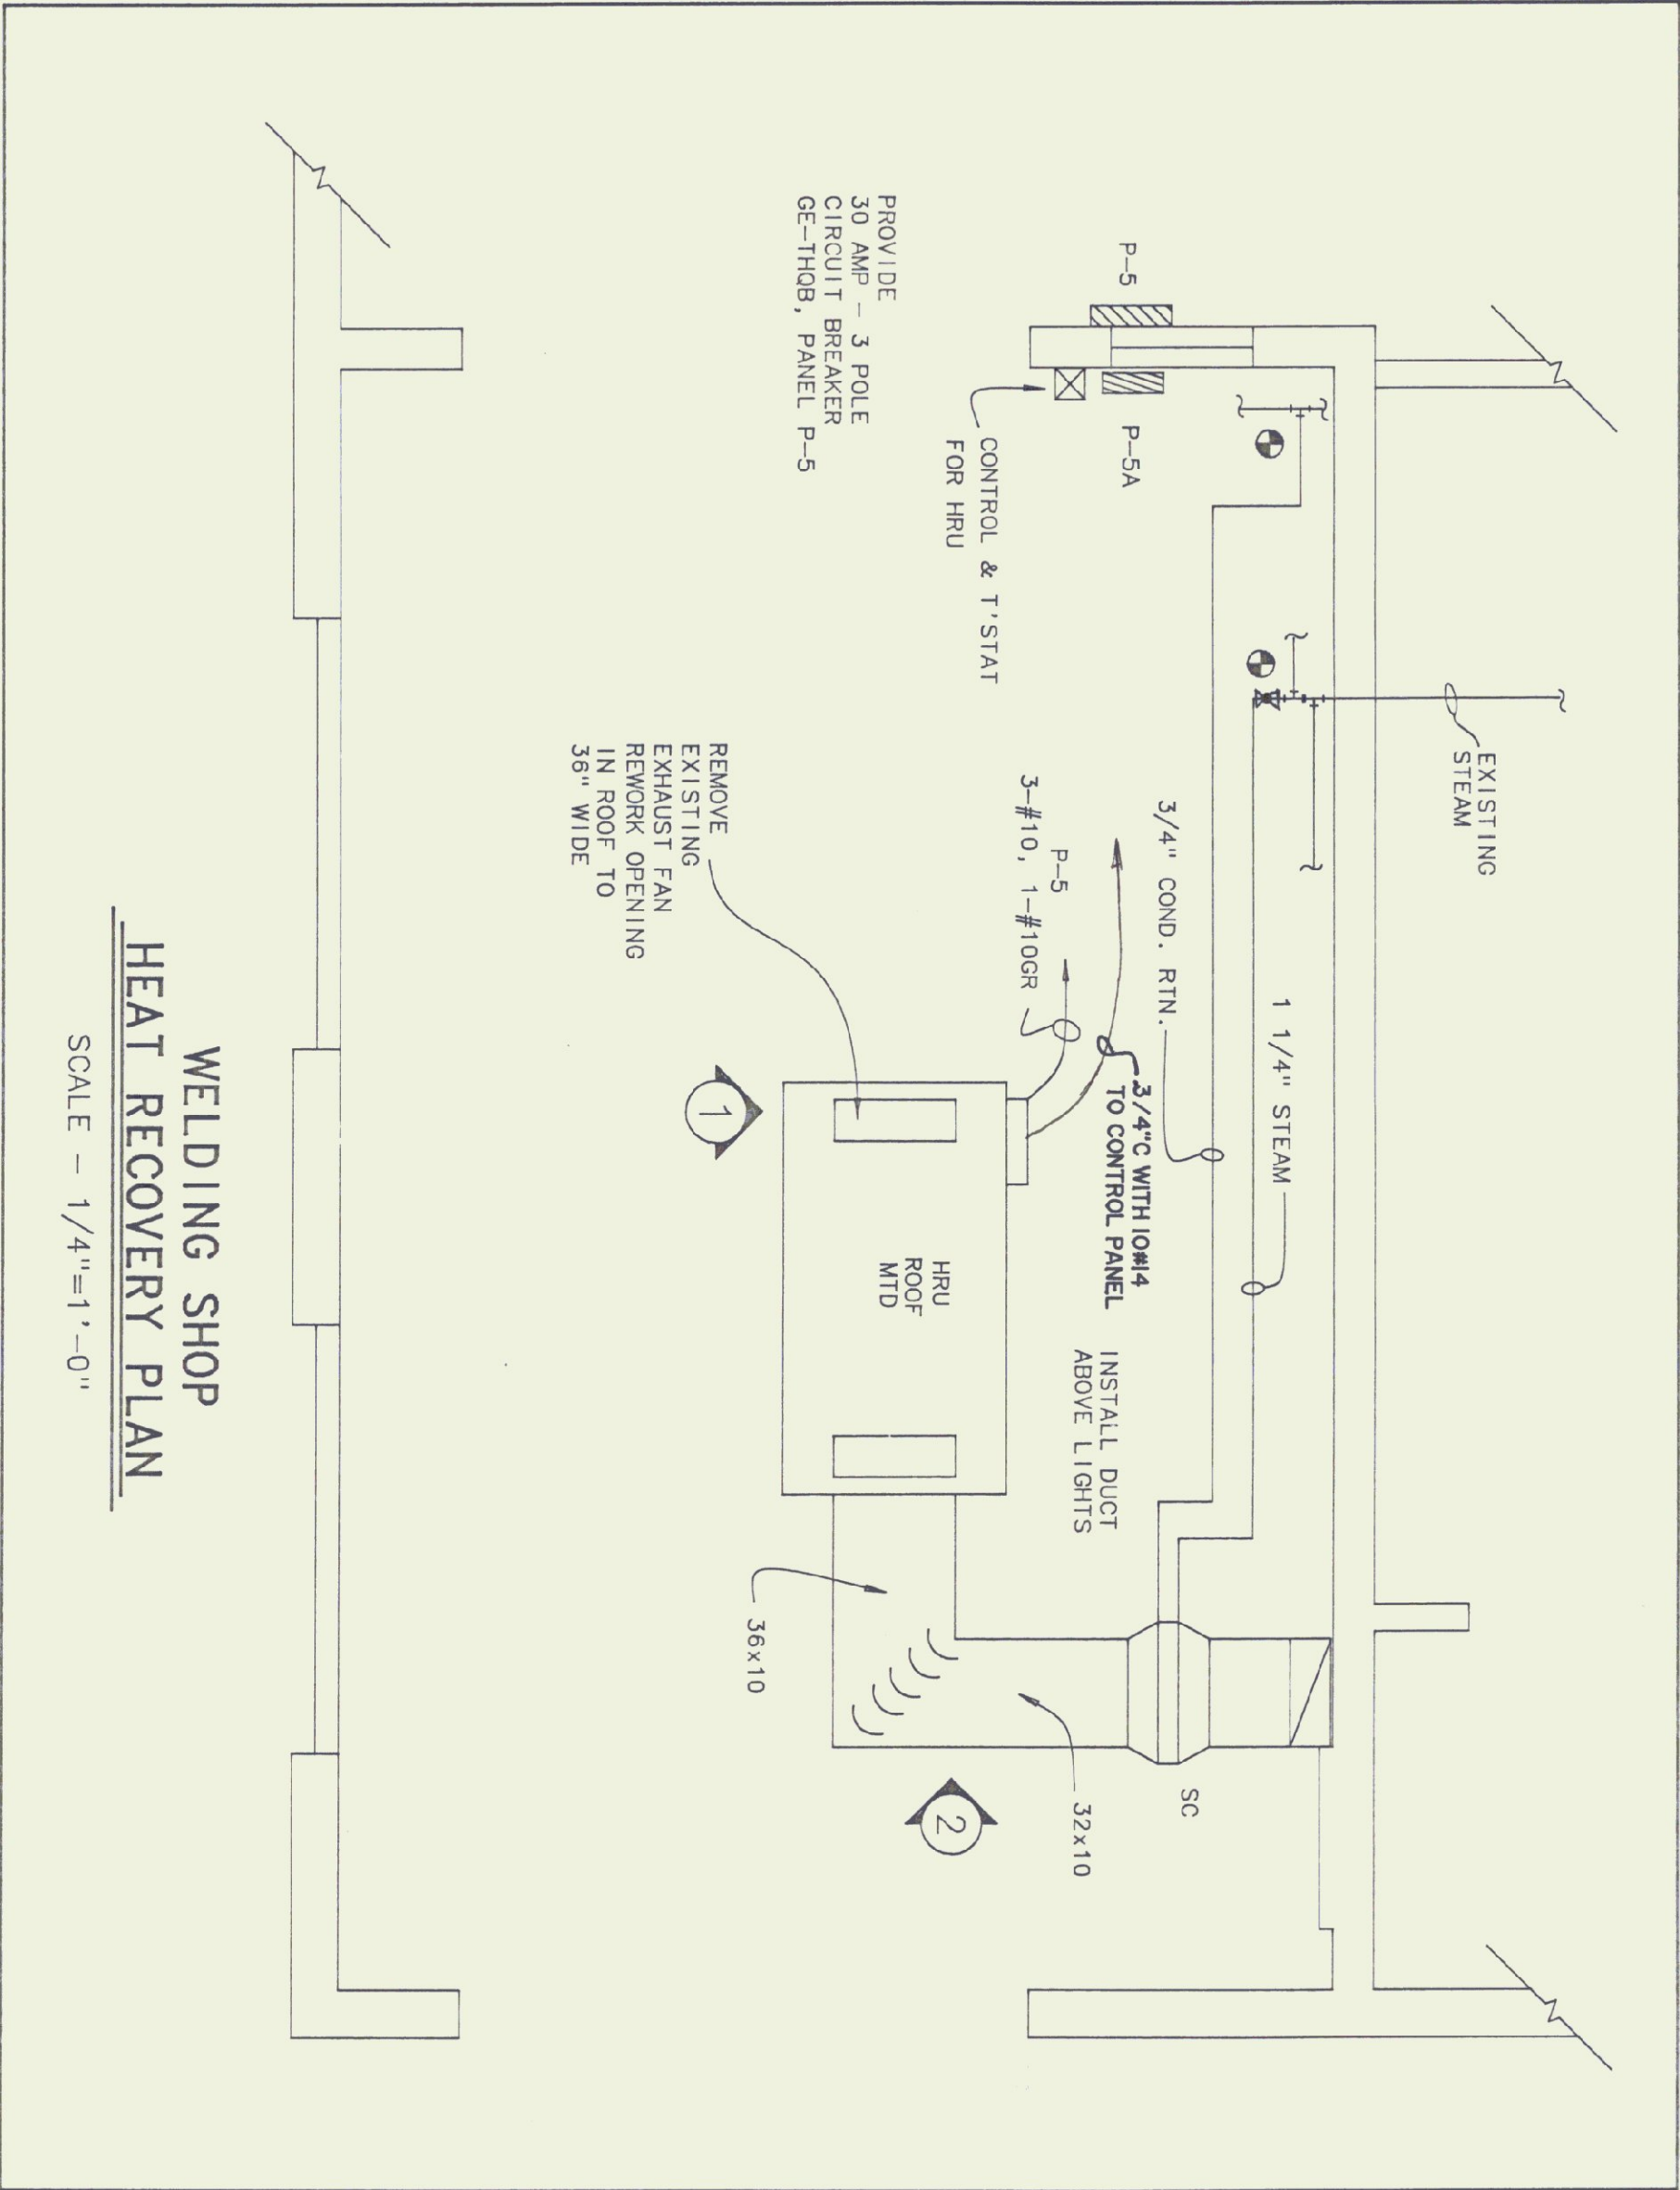
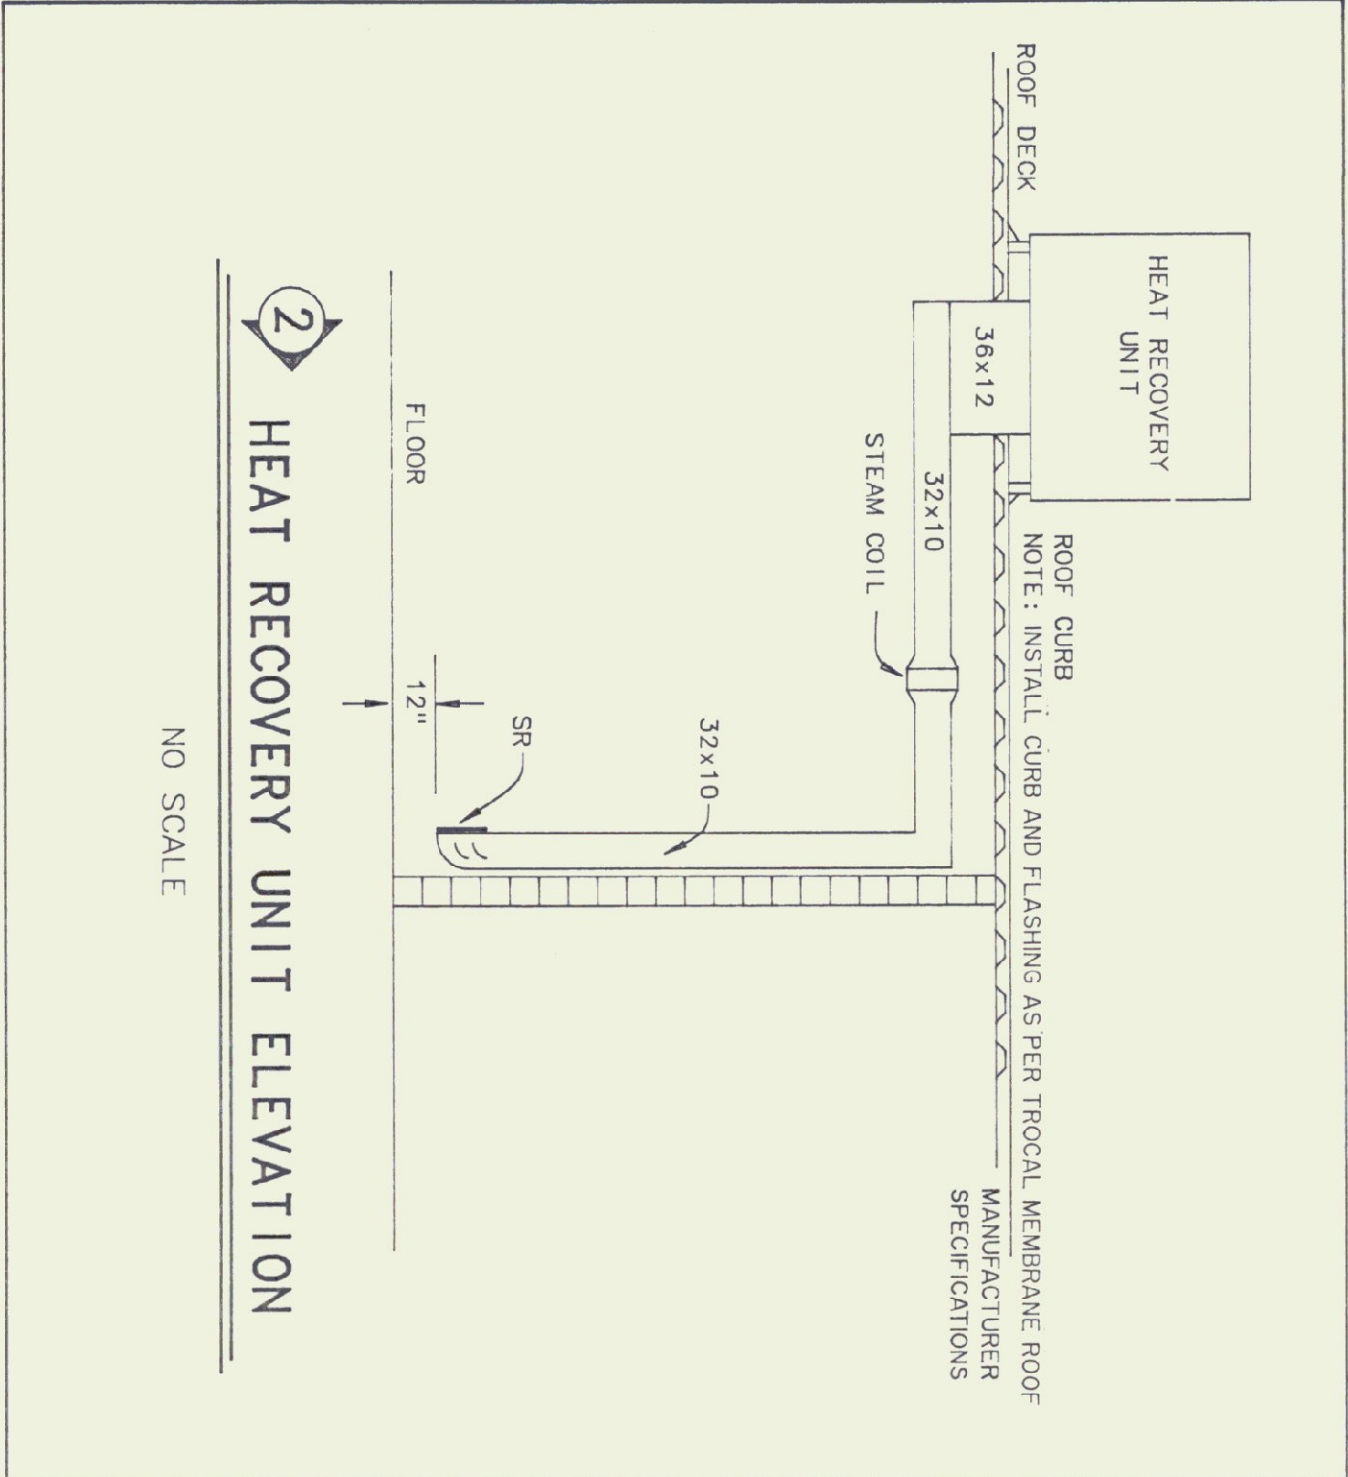
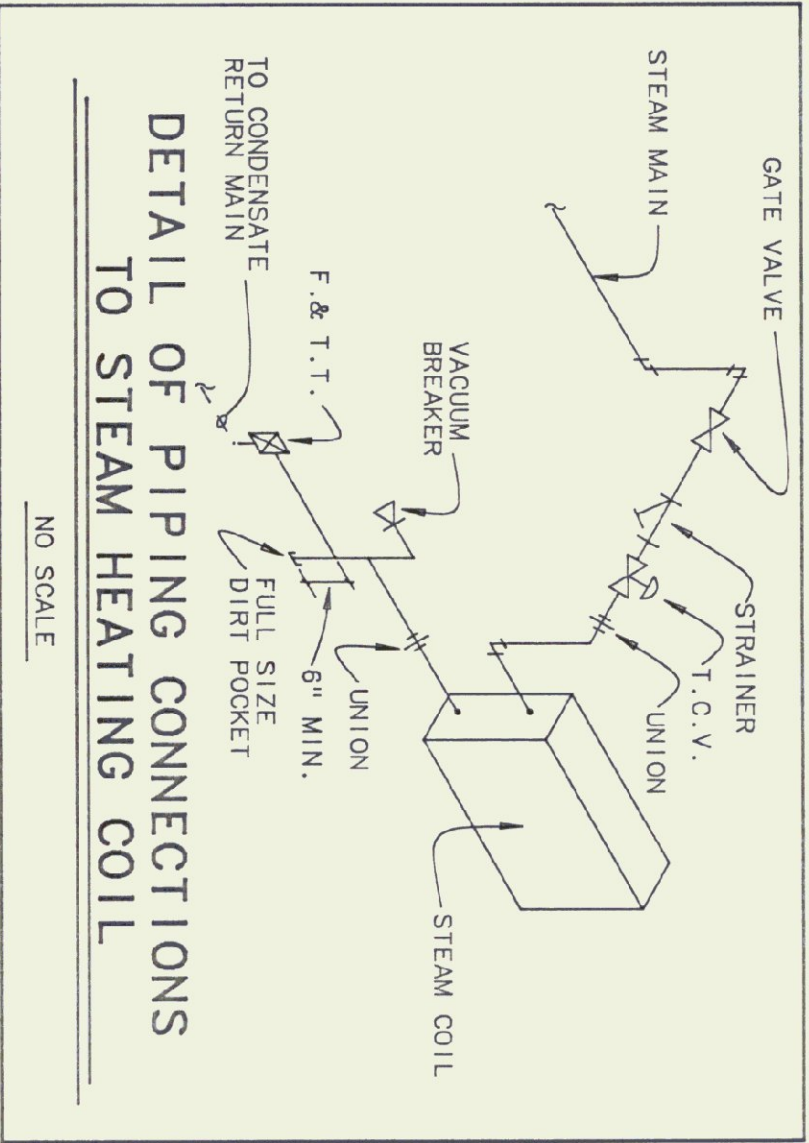


MECHANICAL EQUIPMENT SCHEDULE	
ITEM	DESCRIPTION
HRU	HEAT RECOVERY UNIT - 2,280 CFM SUPPLY AIR AT 7° ESP., 2 HP AT 208 VAC, 3 PHASE, 2,300 CFM RETURN AIR AT 6° ESP., 15 HP AT 208 VAC, 3 PHASE, MODULATING OUTSIDE AIR FACE AND BYPASS DAMPER, OUTSIDE AIR MOTORIZED SHUT OFF DAMPER, EXHAUST AIR GRAVITY BACKDRAFT DAMPER, FARR 3030 SUPPLY AIR FILTERS, ROOF CURB, DES CHAMPS LABORATORIES INC. OR HEATEX
SC	STEAM COIL - FAT 40 DEGREES, LAT 95 DEGREES, CFM 2,280, MAX., 10" P.D., STEAM AT 15 PSI
SR	SUPPLY REGISTER - METAL AIRE SERIES 4200, H4254, EXTRUDED ALUMINUM, SATIN FINISH, 1 1/2" WIDE AIR DEFLECTORS, 1 1/2" CENTERS, ADJUSTABLE DOUBLE DEFLECTION AIR EXTRACTOR, 30" W X 24" H

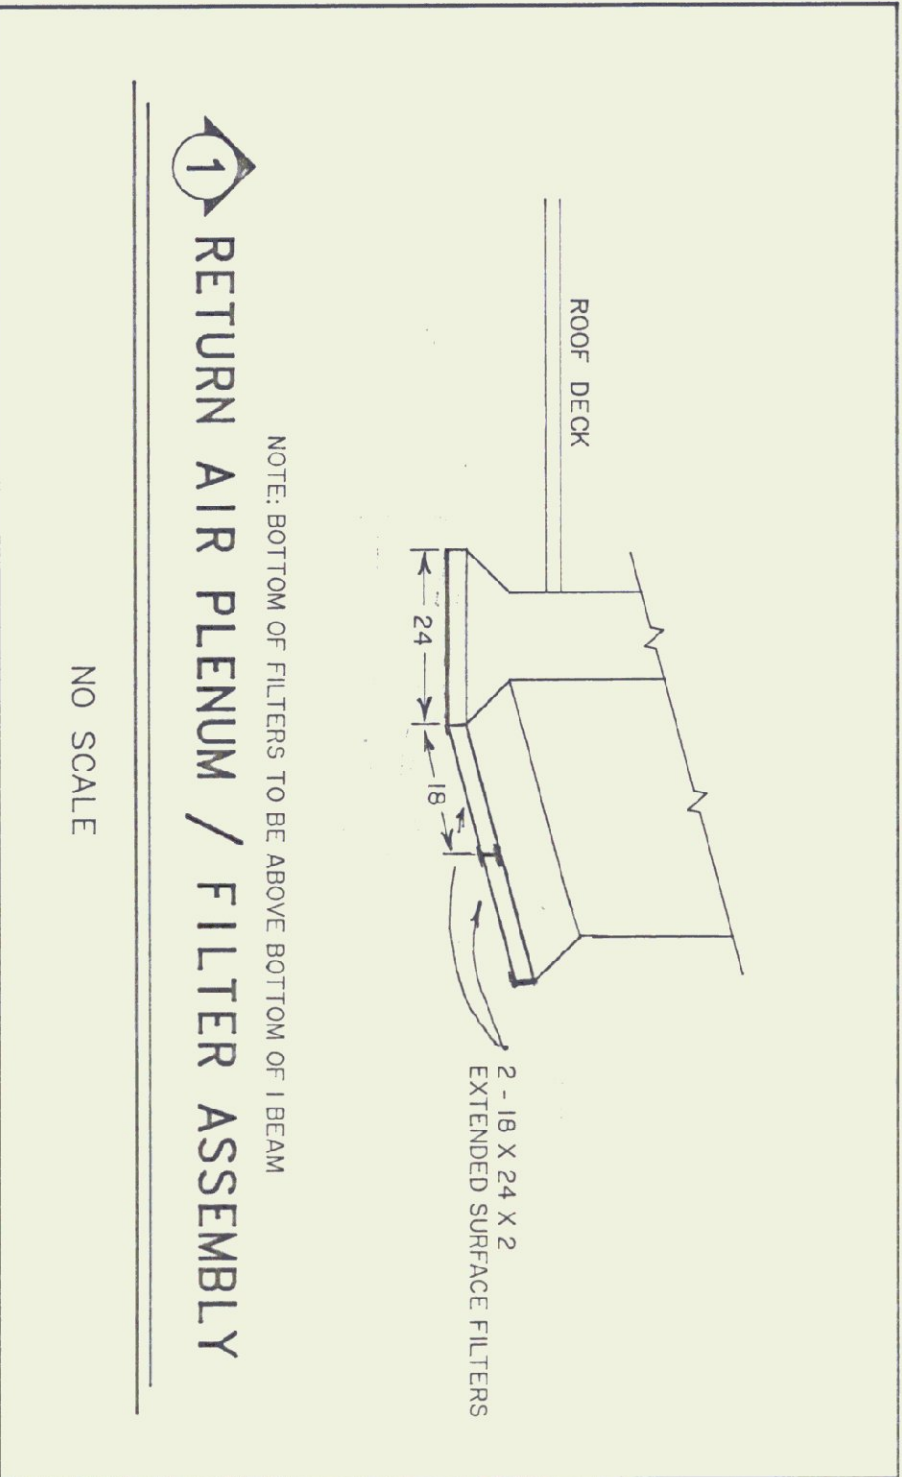

Pearson & Associates
MECHANICAL & ELECTRICAL ENGINEERS
P.O. BOX 610 STOWE, VERMONT 05672
TEL. (802) 253-9607 FAX. (802) 253-9290

STATE OF VERMONT DEPARTMENT OF STATE BUILDINGS AGENCY OF ADMINISTRATION				VERMONT	
MONTPELIER					
AGENCY OF TRANSPORTATION CENTRAL GARAGE BARRE - MONTPELIER ROAD BERLIN, VERMONT					
WELDING SHOP VENTILATION					
DATE: 07/24/92	SCALE: AS SHOWN	REVISIONS:	OAD FILE: PSWELDG	SHEET: 1 OF	DWG NO. 1
DRAWN BY: B.W.M	APPROVED BY: E.S.P				